


ATTACH ROOF PANEL TO BEVELED  
2x BLOCKING W/ SIP FASTENERS  
@ 10" O.C. OR 5 PER 4' PANEL WIDTH.  
TYPICAL UNLESS OTHERWISE NOTED.

STUFF EXPOSED PANEL EDGE  
W/ CONT. 2x MATERIAL. SECURE  
OSB PANEL SKINS TO 2x BLOCKING  
W/ 0.131" DIA. x 2½" LONG  
GALV. NAILS @ 6" O.C. OR EQU.

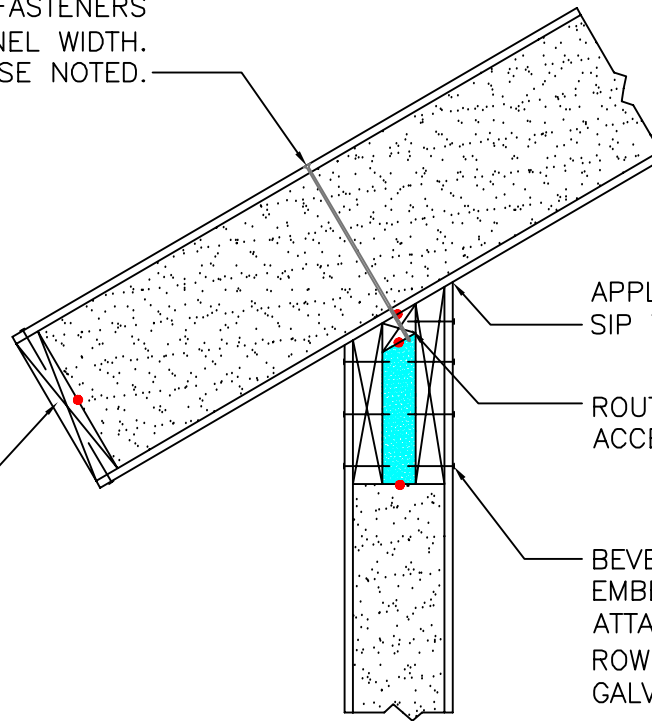

APPLY CORVUM 30/30  
SIP TAPE @ INT. CORNER


ROUT OUT 1½" OF I.H. TO  
ACCEPT BEVELED BLOCKING.

BEVELED INSULATED HEADER  
EMBEDDED IN WALL PANEL,  
ATTACH SKINS TO I.H. W/ 4  
ROWS OF 0.131" DIA. x 2½"  
GALV. NAILS @ 6" O.C. OR EQU.

NOTE: ALL RED DOTS - APPLY CONTINUOUS  
¾" DIA. BEAD OF MASTIC SEALANT  
BETWEEN 2x MEMBER & PANEL FOAM.

BEVELED INSULATED HEADER W/O TOP PLATE

SCALE: 1" = 1'-0"



**Foard**  
P A N E L  
i n c o r p o r a t e d  
P.O. Box 185 , West Chesterfield , NH 03466  
( 603 ) 256 - 8800